


## ROAD CROSS SECTION BEAR MOUNTAIN PARKWAY

NTS

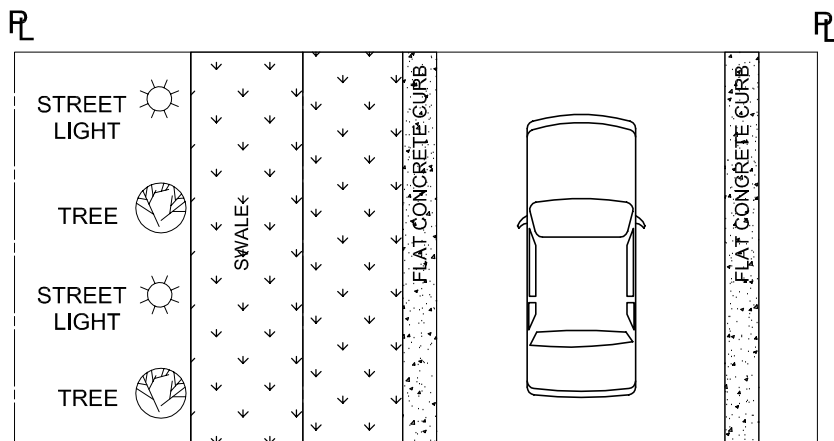

### NOTES:

- \* SPECIAL DESIGN FOR TRAFFIC CALMING AS REQUIRED BY CITY ENGINEER
- \* SERVICES TO BE LOCATED AS SHOWN IN DRAWING.
- SEWERS & DRAINS**
  - MAY BE IN THE SAME TRENCH IF THERE IS A MIN 150mm LATERAL CLEARANCE BETWEEN THE OUTSIDE COUPLINGS OR BELLS OF THE PIPES AND IF THE ELEVATIONS ARE SIMILAR.
  - MUST BE 1.0m CLEAR OF OTHER UTILITIES.
- WATER**
  - MUST BE 1.5m CLEAR OF UNDERGROUND HYDRO.
  - MUST BE 3.0m CLEAR OF SEWER.
  - MUST BE 1.0m CLEAR OF LAMP STANDARD BASES.
- HYDRANTS**
  - MUST BE 3.0m CLEAR OF ANY ABOVE GROUND STRUCTURES AND LAMP STANDARDS.
  - LOCATION OF FIRE HYDRANT IN ACCORDANCE WITH FIRE PLAN.

**BEAR MOUNTAIN ESTATES**

10m R/W



**CITY OF LANGFORD  
ENGINEERING DEPARTMENT**

DATE:  
FEB 2004

DRAWN:  
ID

SCALE:  
NTS

APPROVED:  
MB

**BM5**